




RESTS
EXISTING
FIRST
FLOOR
FLANK
WINDOW.

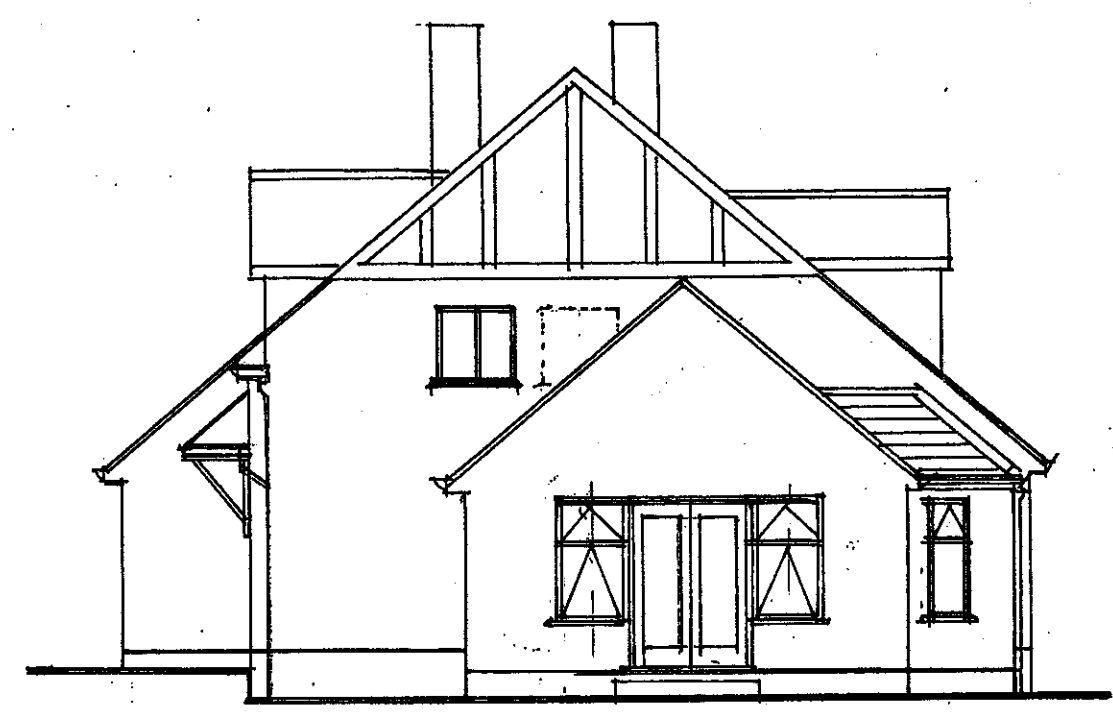

PROPOSED SOUTH ELEVATION

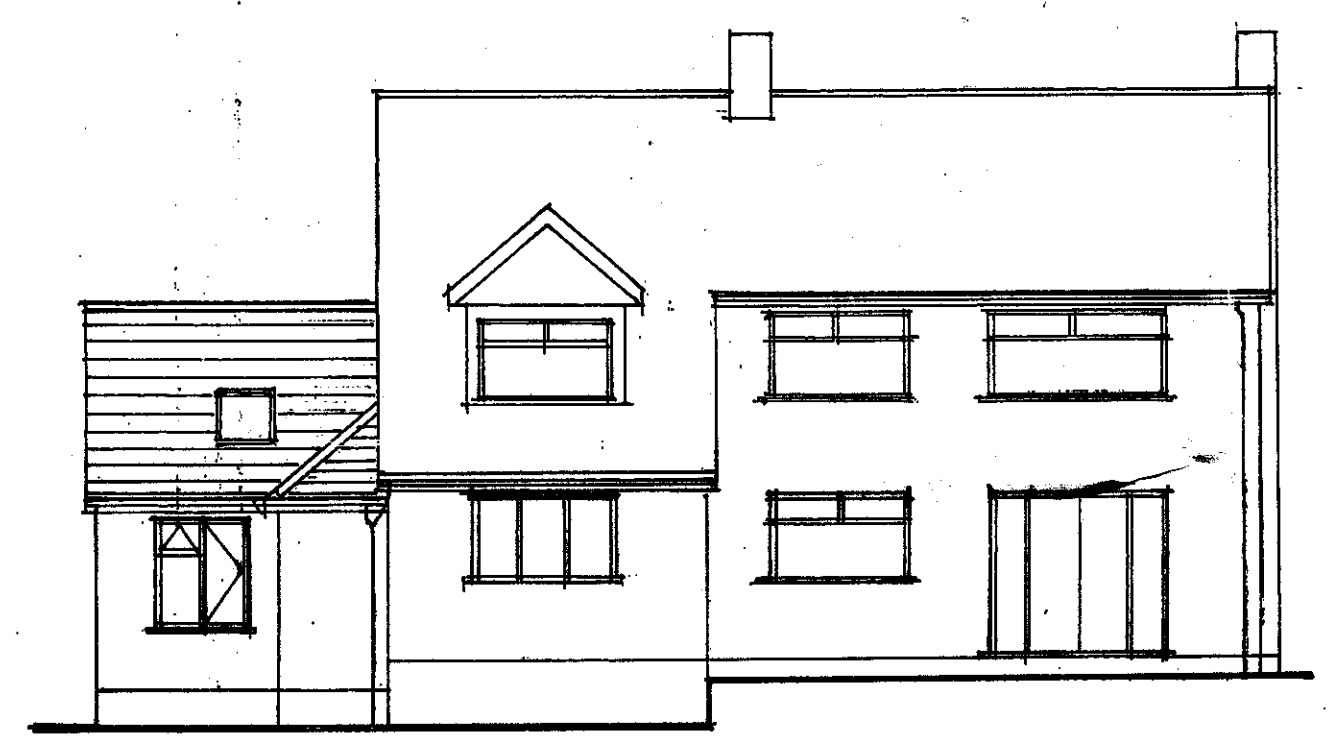


PROPOSED REAR ELEVATION

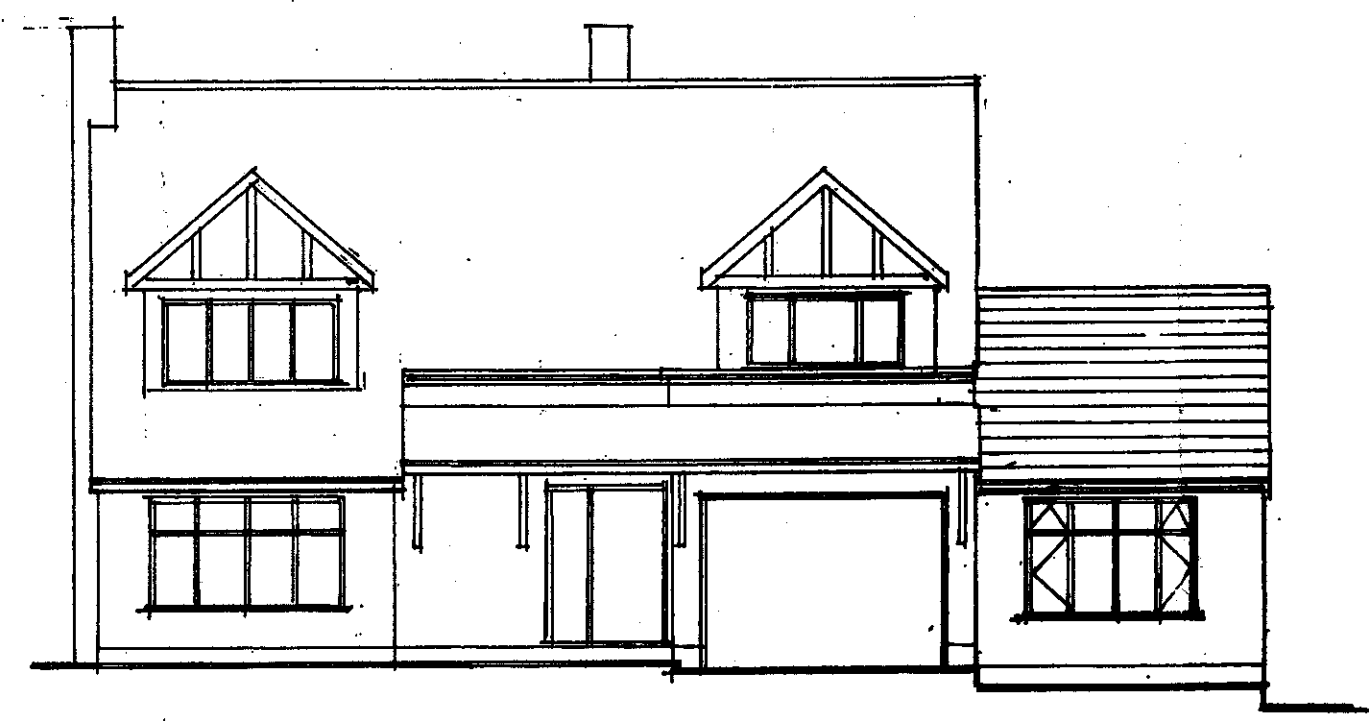


PROPOSED FRONT ELEVATION

ALL NEW
FINISHES
TO MATCH
EXISTING.
FACE BRICK
TO MATCH
EXISTING

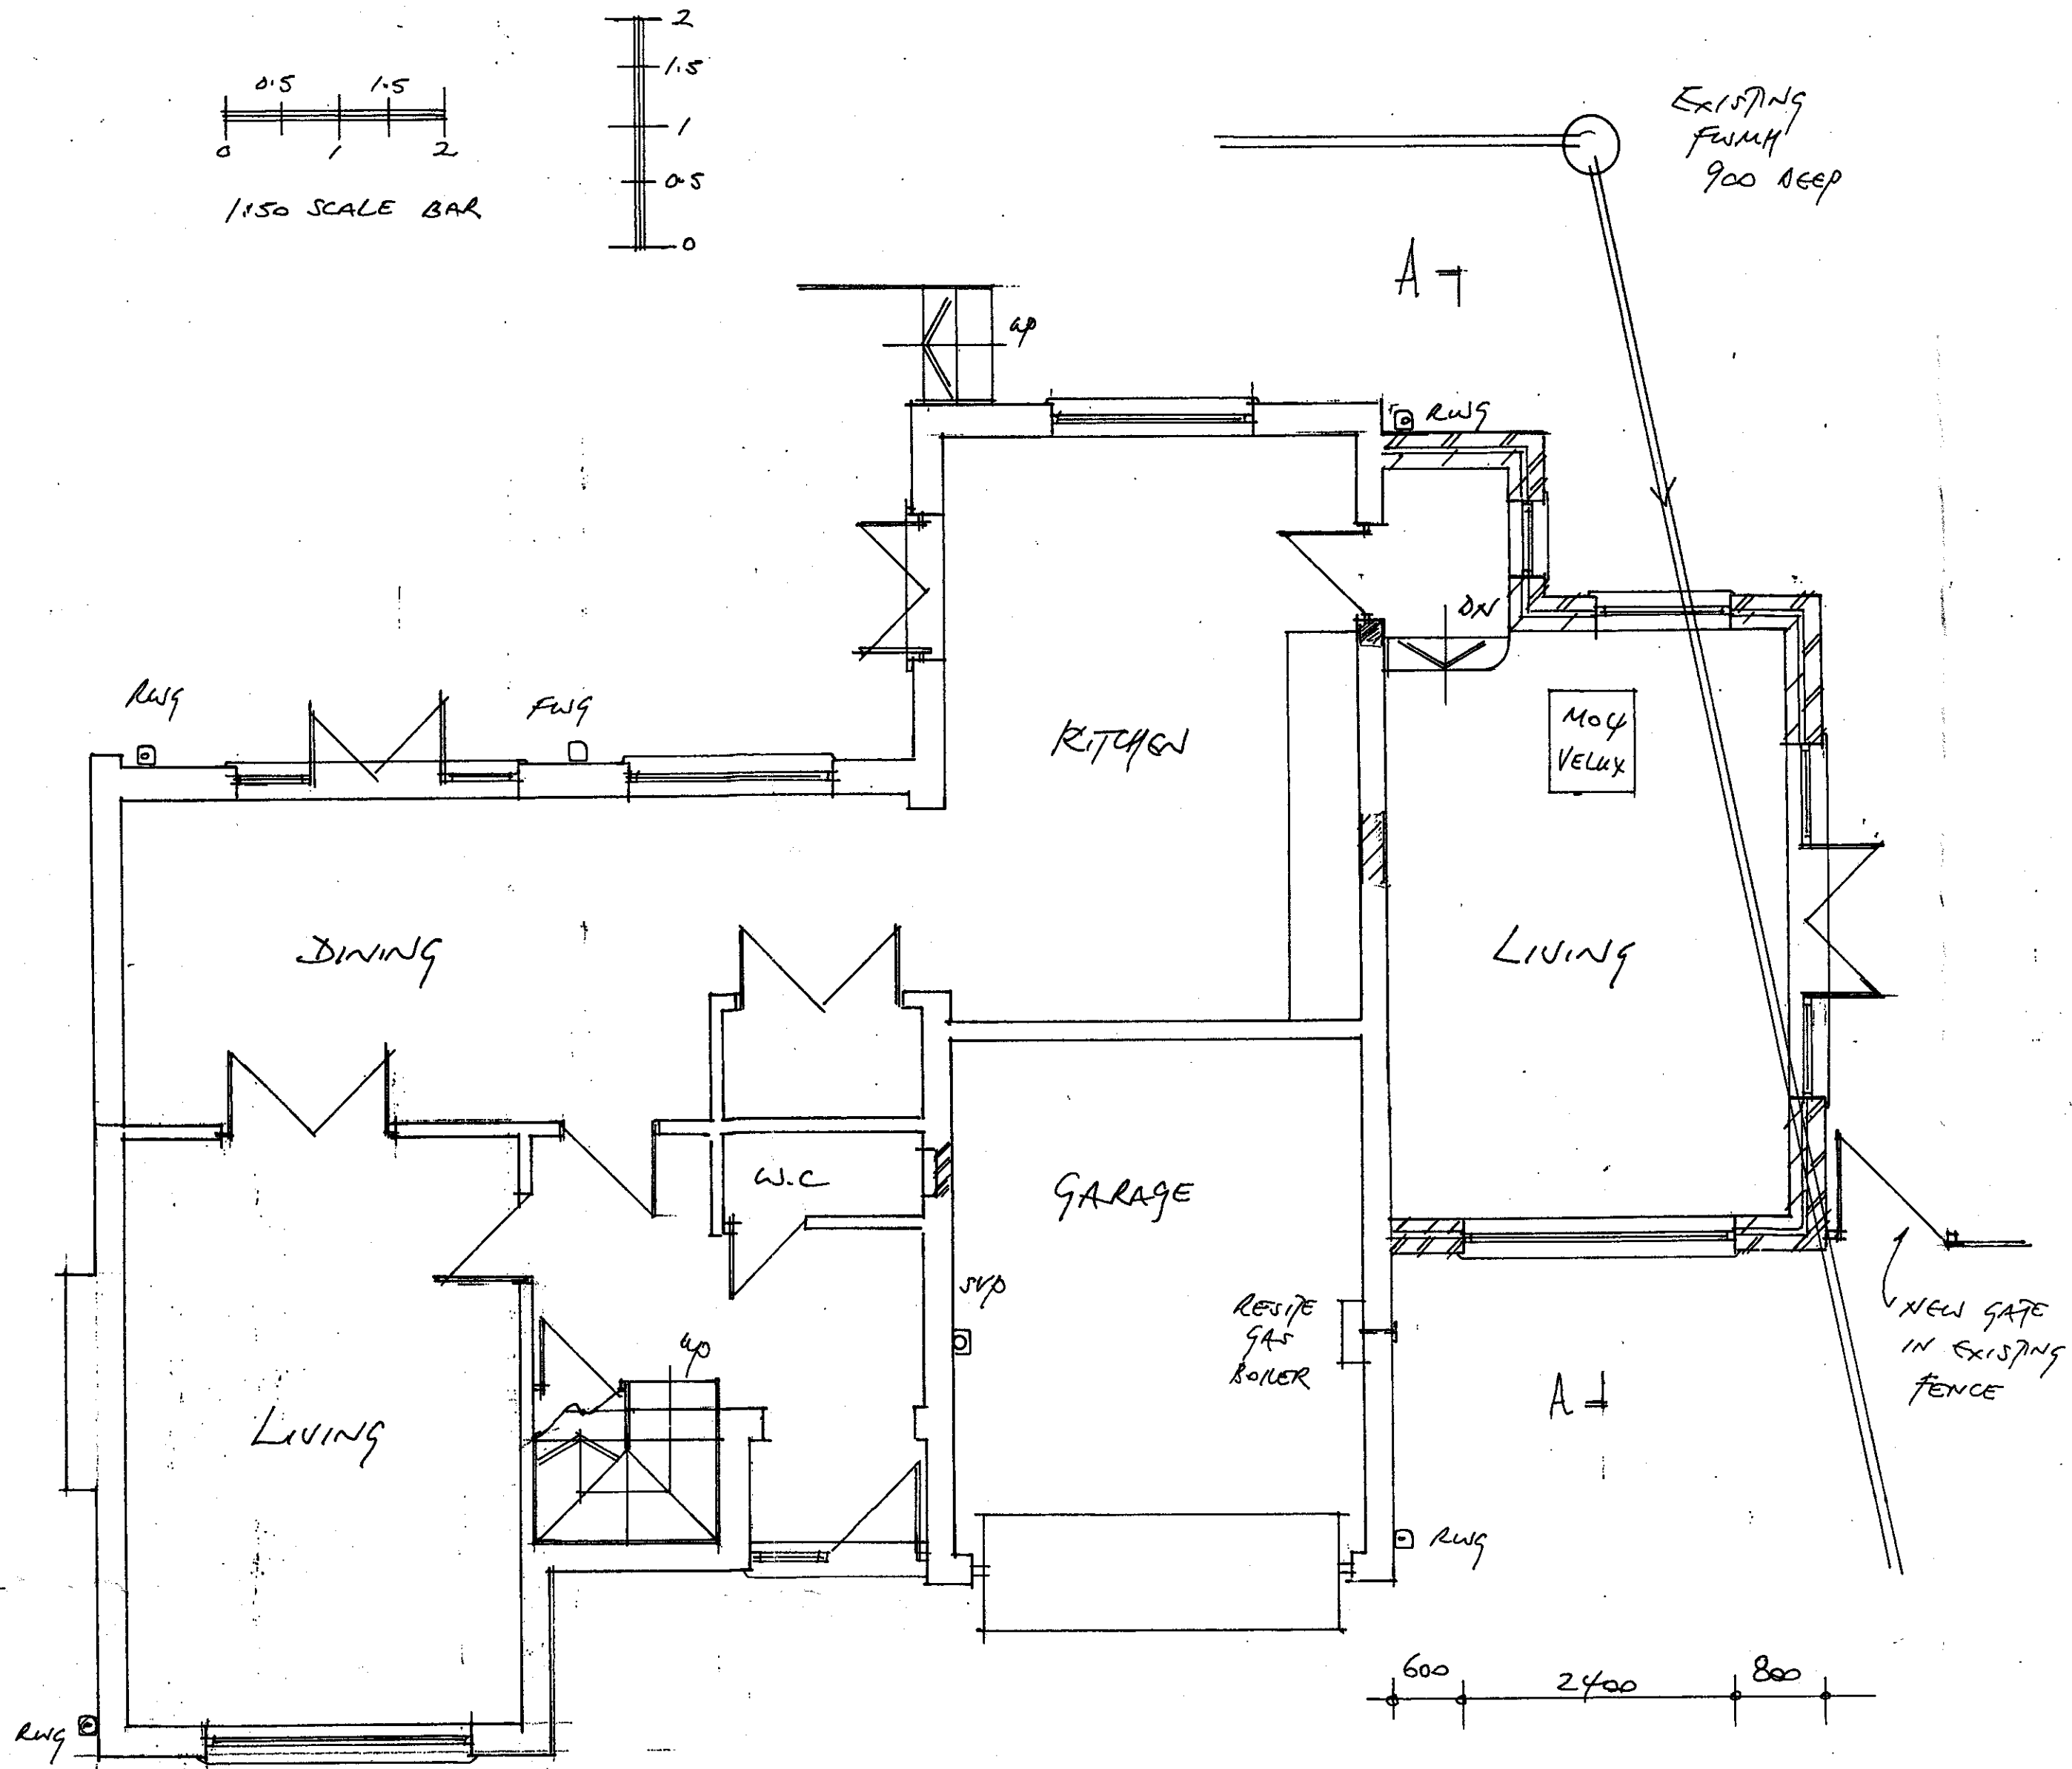

PROPOSED GROUND FLOOR

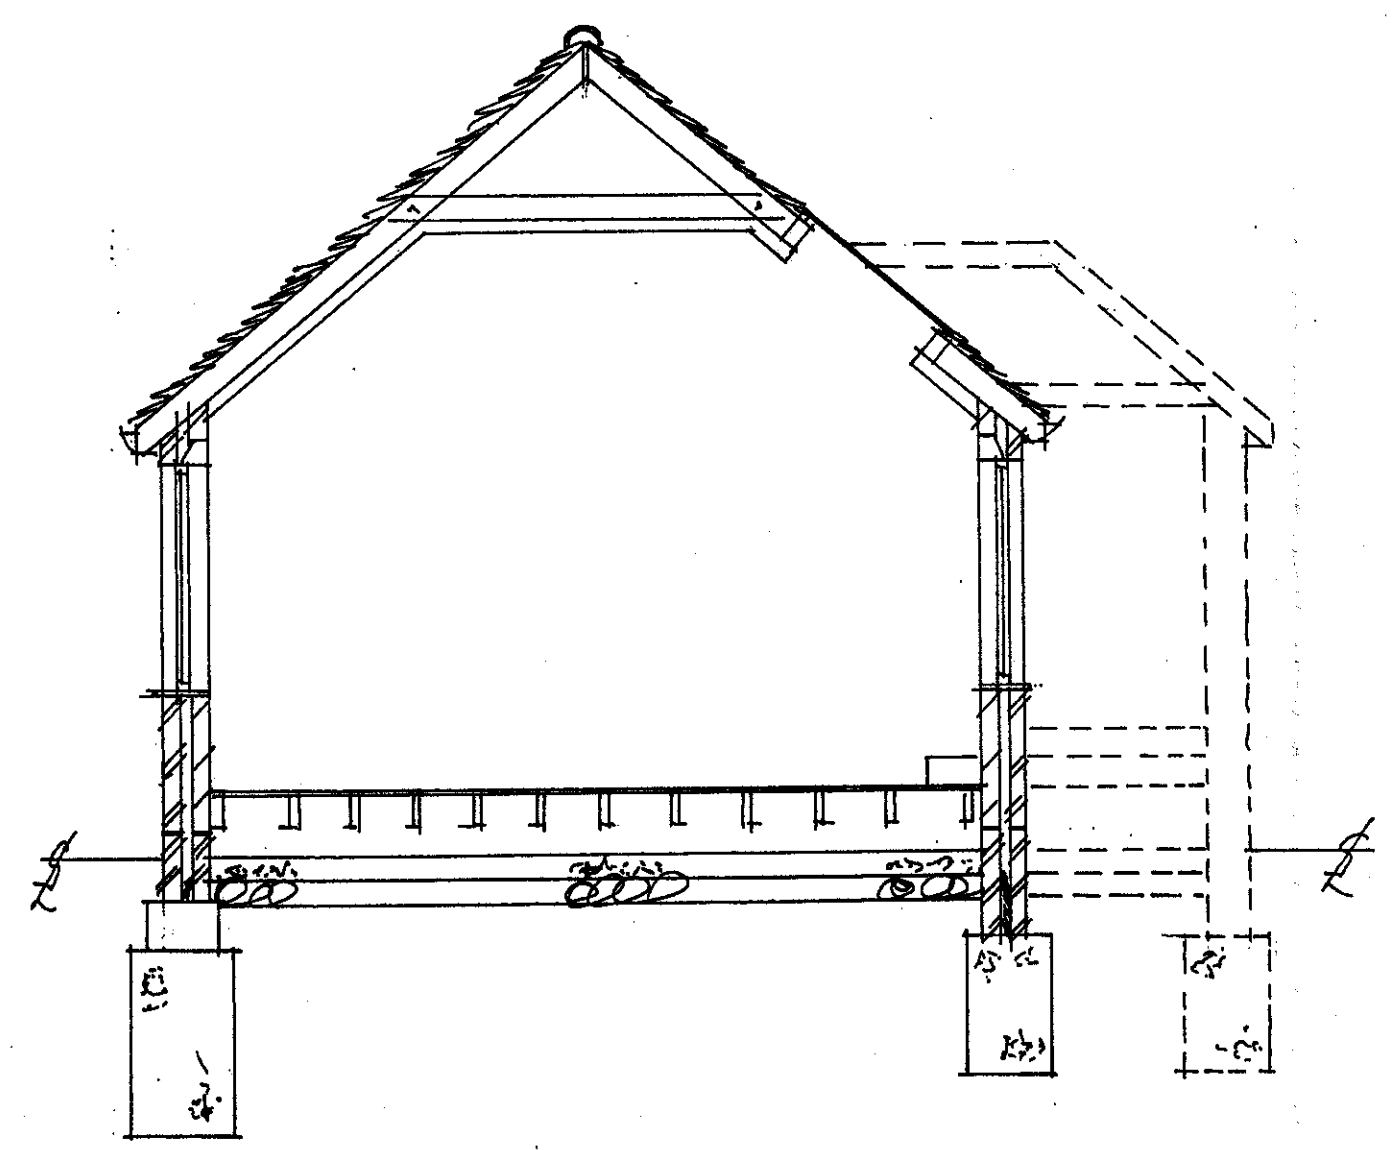

SECTION AA

- NOTES:**
- Copyright: The contents of this drawing may not be reproduced in whole or in part without the written consent of D.L. Jackson.
 - No site dimensions to be scaled from this drawing, and all dimensions to be verified on site.
 - All dimensions, levels and drain lines to be checked on site prior to commencement and any discrepancies notified directly to the surveyor.
 - All works to be carried out in accordance with the bye-laws and regulations of the local authority.
 - All work to comply with the latest code of practice and British Standards specification.
 - FOUNDATIONS:** To be taken down to a suitable level to local authority approval and below adjacent drainage levels and 600mm below tree root action depending on site conditions. Foundation concrete to be 1:2:4 mix strength 21N. Foundation depths are to be in accordance with NHBC practice notes and tables.
 - DRAINAGE:** All drains to be 100mm stoneware pipe laid to fall 1:40min. flexible jointed in 150mm pea shingle. New and existing drainage under building to be protected with 150mm concrete surround. Drains passing under walls protected with reinforced concrete linings. New manholes built in 225mm semi-engineering bricks on 150mm concrete base. All to comply with BS 8301:1985. Single stack plumbing to comply with BS 5572 with 75mm deep seal traps to fittings. Rodding access at all changes in direction. Waste pipes over 2.30 long to be 50mm dia. Rainwater gutters to be 112mm pvc and rwp's in 63mm pvc. Remove any redundant drains.
 - WALLS:** Cavity walls constructed with 100 mm brickwork 75mm cavity and 100mm celcon solar block inner skin, with five stainless steel wall ties per square metre and with 75mm of Dritherm 32 insulation in the cavity. Provide all cavity closers with insulated cavity closer and wall ties at 225mm crs. Internal finish of 13mm light weight plaster.
Solid walls constructed with 215mm celcon solar blocks finished externally with 20mm two coat waterproof render BS 5262 and with 50mm gyproc thermal board super on gyproc adhesive dabs internally with skim plaster finish.
All new walls and dpc's bonded to existing work with brickwork only below dpc level and all new walls to be taken up to the underside of roof boarding. Stainless steel furfix anchors at junction of new and existing walls.
 - FLOORS:** Solid floors of 65mm cement sand screed finish with 1200 gauge polythene damp proof membrane lapped into wall damp proof course, 150mm thick concrete slab on 150mm thick hardcore bedded with sand. Existing timber floors ventilated by use of 100mm diameter ducts set in floor at 1 metre centres to terminate at airbricks in new walls. Insulate solid floors with 80mm Celotex GA 3000Z insulation under floor slab and on dpm laid over blinded hardcore.
Timber Floors of 21mm t + g flooring on 150 x 50 joists at 400mm centres on 100 x 75mm plates on BS 743 dpc on brick honeycomb sleeper walls at 1 metre centres on 100mm thick oversite concrete on 150mm hardcore. Provide 150mm air space under joists, and air bricks in outer wall at 1m centres. All floor timbers to be treated with preservative. Insulate timber floor voids with 80mm of Celotex GA 3000 insulation.
 - FLAT ROOFS:** Constructed with 3 layer felt to BS 747 and CP144, and with roof insulation of 115mm Celotex Tempchek Decking TD on timber joists at 400mm centres with firing pieces for a fall of 1:40 min. Roof finished in 12mm spar chippings bedded with hot bitumen. Ceiling finished in 12.5mm plasterboard with skim finish. New joists to be tied down with 30 x 5mm mild steel straps built into walls at 1.8 metre centres and screwed to joists. Ends of all roof timbers, fascias and soffit boards to be treated with preservative.
 - PITCHED ROOFS:** With tiles on treated 25 x 38mm softwood battens with breathable roofing membrane on 100 x 50mm rafters at 400mm centres. Wall plates of 100 x 50mm with 30 x 5mm mild steel straps at 1.8m centres. Purlins of 175 x 75mm with 100 x 75mm struts at 1.2m centres. Insulate roof voids with 280mm Rockwool and treat timber.
 - VENTILATION:** All rooms to be provided with 1/20th of the floor area in opening windows and all windows to be double glazed. All rooms to have permanent ventilation of 8000 square mm. Kitchens to have mechanical extract of 60 litres per second. Bathrooms to have mechanical extract of 15 litres per second. Utility rooms with extract of 30 litres per second.
 - DOUBLE GLAZING:** To be in timber or upvc frames with minimum 16mm air gap with low E glass. Doors and side lights with safety glass to BS 6206. Installer to provide certificate to show glazing complies with current buildings regulations.
 - ELECTRICAL:** All electrical works are to comply with part P (electrical safety) and be installed by a NICEIC registered contractor who will issue a BS 7671 completion certificate for the installation.
 - PARTY WALL etc ACT 1996:** Written notice must be given to adjoining owners prior to the start of work on site, 2 months notice for works to party wall or party structure, one months notice for all other works.

Amendments	
Project	PROPOSED EXTENSION AT 14, CHURCH CLOSE, CUFFLEY, HERTS EN6 4LS
Client	MR + MRS CARTER
Drawn	JANUARY 2012 CC/01
Scales	1:100 1:50 1:1250
D. L. JACKSON M.C.I.O.B. M.B.Eng. M.R.S.P.H. BUILDING SURVEYOR AND ARCHITECTURAL DESIGNER	
31 KING JAMES AVENUE, CUFFLEY, HERTS. EN6 4LN	
Tel: 01707 888948 Mobile: 07836 345 878	
Enfield Design Award Winner 2003	

PLANNING DEPARTMENT
OFFICE COPY
12 JAN 2012
2012/008