

Notes

This drawing is the Copyright of blyth developments, and may not be reproduced or copied, in whole or in part, without express permission.

Figured dimensions shall be used in preference to scaled dimensions. All dimensions shall be checked on site before commencing works.


*All work shall comply with the latest Building Regulations and be to the satisfaction of the Local Authority.

*Workmanship and methods of construction shall be at least to the standard prescribed by the relevant Codes of Practice.

Materials shall be suitable for the purpose for which they are used and the quality shall not be lower than that defined in the relevant British or Continental Standard so designated.

General Specifications

- All drainage shown on this drawing is assumed only and it is the contractors responsibility to check exact depths and locations prior to the commencement of the works.
- Any new or proposed drains found under the proposed extension are to be encased in 150mm concrete and reinforced concrete lintels are to be provided in the walls above the drain run.
- Existing sub-floor ventilation is to be maintained (if necessary) by providing 100mm dia pvc ducts extending from the existing air bricks to new 225 x 150mm air bricks in the new external walls.
- All glazing is to be double glazed and to be to BS6206 and any glazing within 900mm of the floor level is to be toughened or laminated in accordance with Part N.
- All new habitable rooms are to be provided with permanent ventilation of 8000mm³, and this is to be achieved by providing either trickle vents in the door/window design or by air bricks within the room.
- Provide vertical and horizontal dpc's at all reveals, and all lintels are to have a minimum bearing of 150mm.
- All steel beams are to be encased in 2 layers of 12.5mm plaster board and skim coat of plaster to achieve a fire rating of 1/2 hour.
- All timbers used in the construction of this project are to be to SG3 grade.
- All glazing is to be low E glass with 16mm air gaps between panes.
- Provide one low energy light fitting in new extensions.
- All electrical work required to meet the requirements of Part P (Electrical Safety) must be designed, installed, inspected and tested by a person competent to do so. Prior to completion the Council should be satisfied that Part P has been complied with. This may require an appropriate BS 7671 electrical installation certificate to be issued for the work by a person competent to do so.

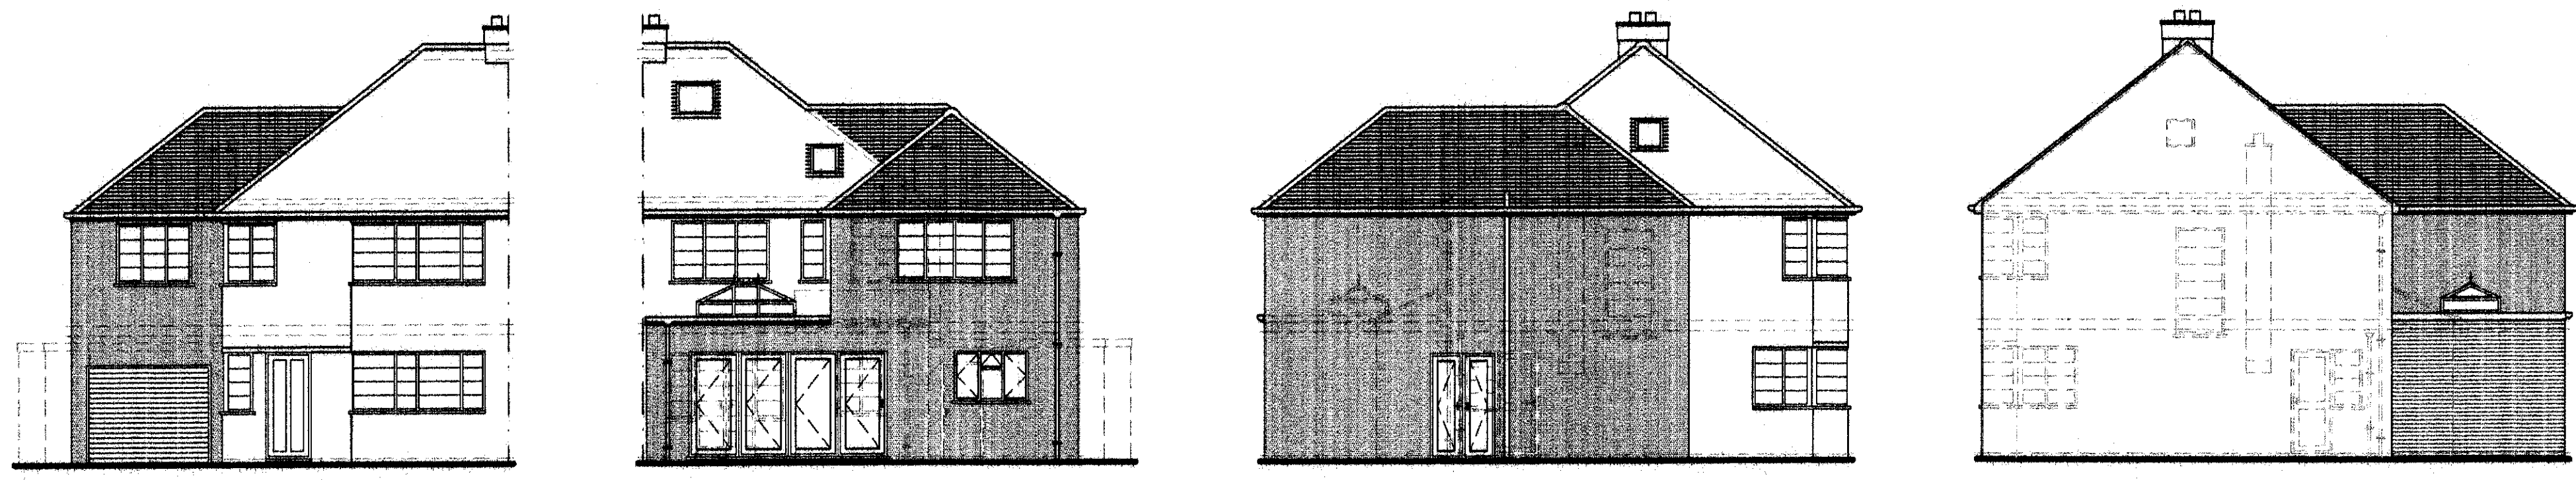


front elevation

rear elevation

side elevation

side elevation

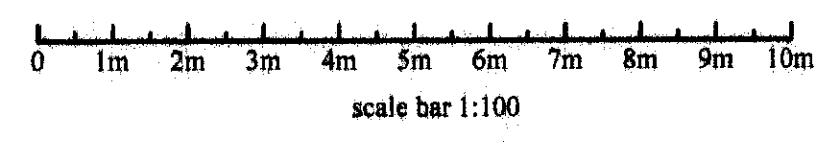

Cavity blockwork: 25mm waterproof sand/cement render in 2 coats mix 1:1:6 on 100mm Thermalite TURBO blocks, 100mm cavity with 50mm rigid fibreglass insulation and 100mm Thermalite standard 4n/mm² block inner skin and 13mm plaster finish.

Provide stainless steel twisted cavity wall ties at 750mm horizontal centres and 450mm staggered vertical centres. Ties to be doubled up at corners and reveals.

Provide insulated cavity closers to all new reveals.

Note: - External walls to achieve a minimum 'U' value of 0.30w/m²K.

Note: - The proposed habitable rooms are each to be provided with an openable window with an unobstructed area of minimum 0.33m² with a minimum 450mm dimension in either direction. (i.e. Clear unobstructed aperture to be minimum 750x450mm - with escape hinges). The cill height of these windows should fall between 800-1100mm. First floor windows with a cill height below 800mm are to provide adequate protection against falling - safety glass and child proof restrictors to be fitted.

63mm rwp to connect to existing surface water drain or taken via 100mm hepsleeve drains laid on 150mm pea shingle to a soakaway located 5m away from any building.

Note: - Provide mechanical ventilation to kitchen ducted to fresh air with an extract rate of 60 litres/sec or if a cooker hood is provided the rate can be reduced to 30 litres/sec.

No part of the construction to encroach the boundary.

Remove walls as shown dotted and provide new steel beams over to engineer's detail, and cut back brickwork as required.


Note: - Please refer to Structural Engineers design for beam and associated supports.

All new wastes to utility and ensuite to be 40mm fitted with 75mm deep seal traps and cleaning eyes provided at changes of direction and connected to existing or new s.v.p.


Note: - Provide mechanical ventilation ducted to fresh air to utility and ensuite with an extract rate of 30 litres/sec operated by means of the light switch with a minimum of 15 minutes overrun.

Form all new timber stud partitions as shown on the drawing constructed in 100x50mm softwood timber at 400mm centres with 12.5mm plaster board and skim coat of plaster to both sides and infill with 100mm rockwall insulation. All new studs to be built of double joists bolted together with M12 Bolts at 600mm centres.


New floor should be constructed so as to provide reasonable resistance to sound transmission, in accordance with AD E2, i.e. 22mm T & G or 20mm Chipboard floor boarding, 100mm acoustic quilt between joists, ceiling lining to be 12.5mm British Gypsum SoundBloc plasterboard or equal 10kg/m² density boarding. Note that constructional make-up to comply with AD E2 will be deemed to provide at least half-hour fire resistance.

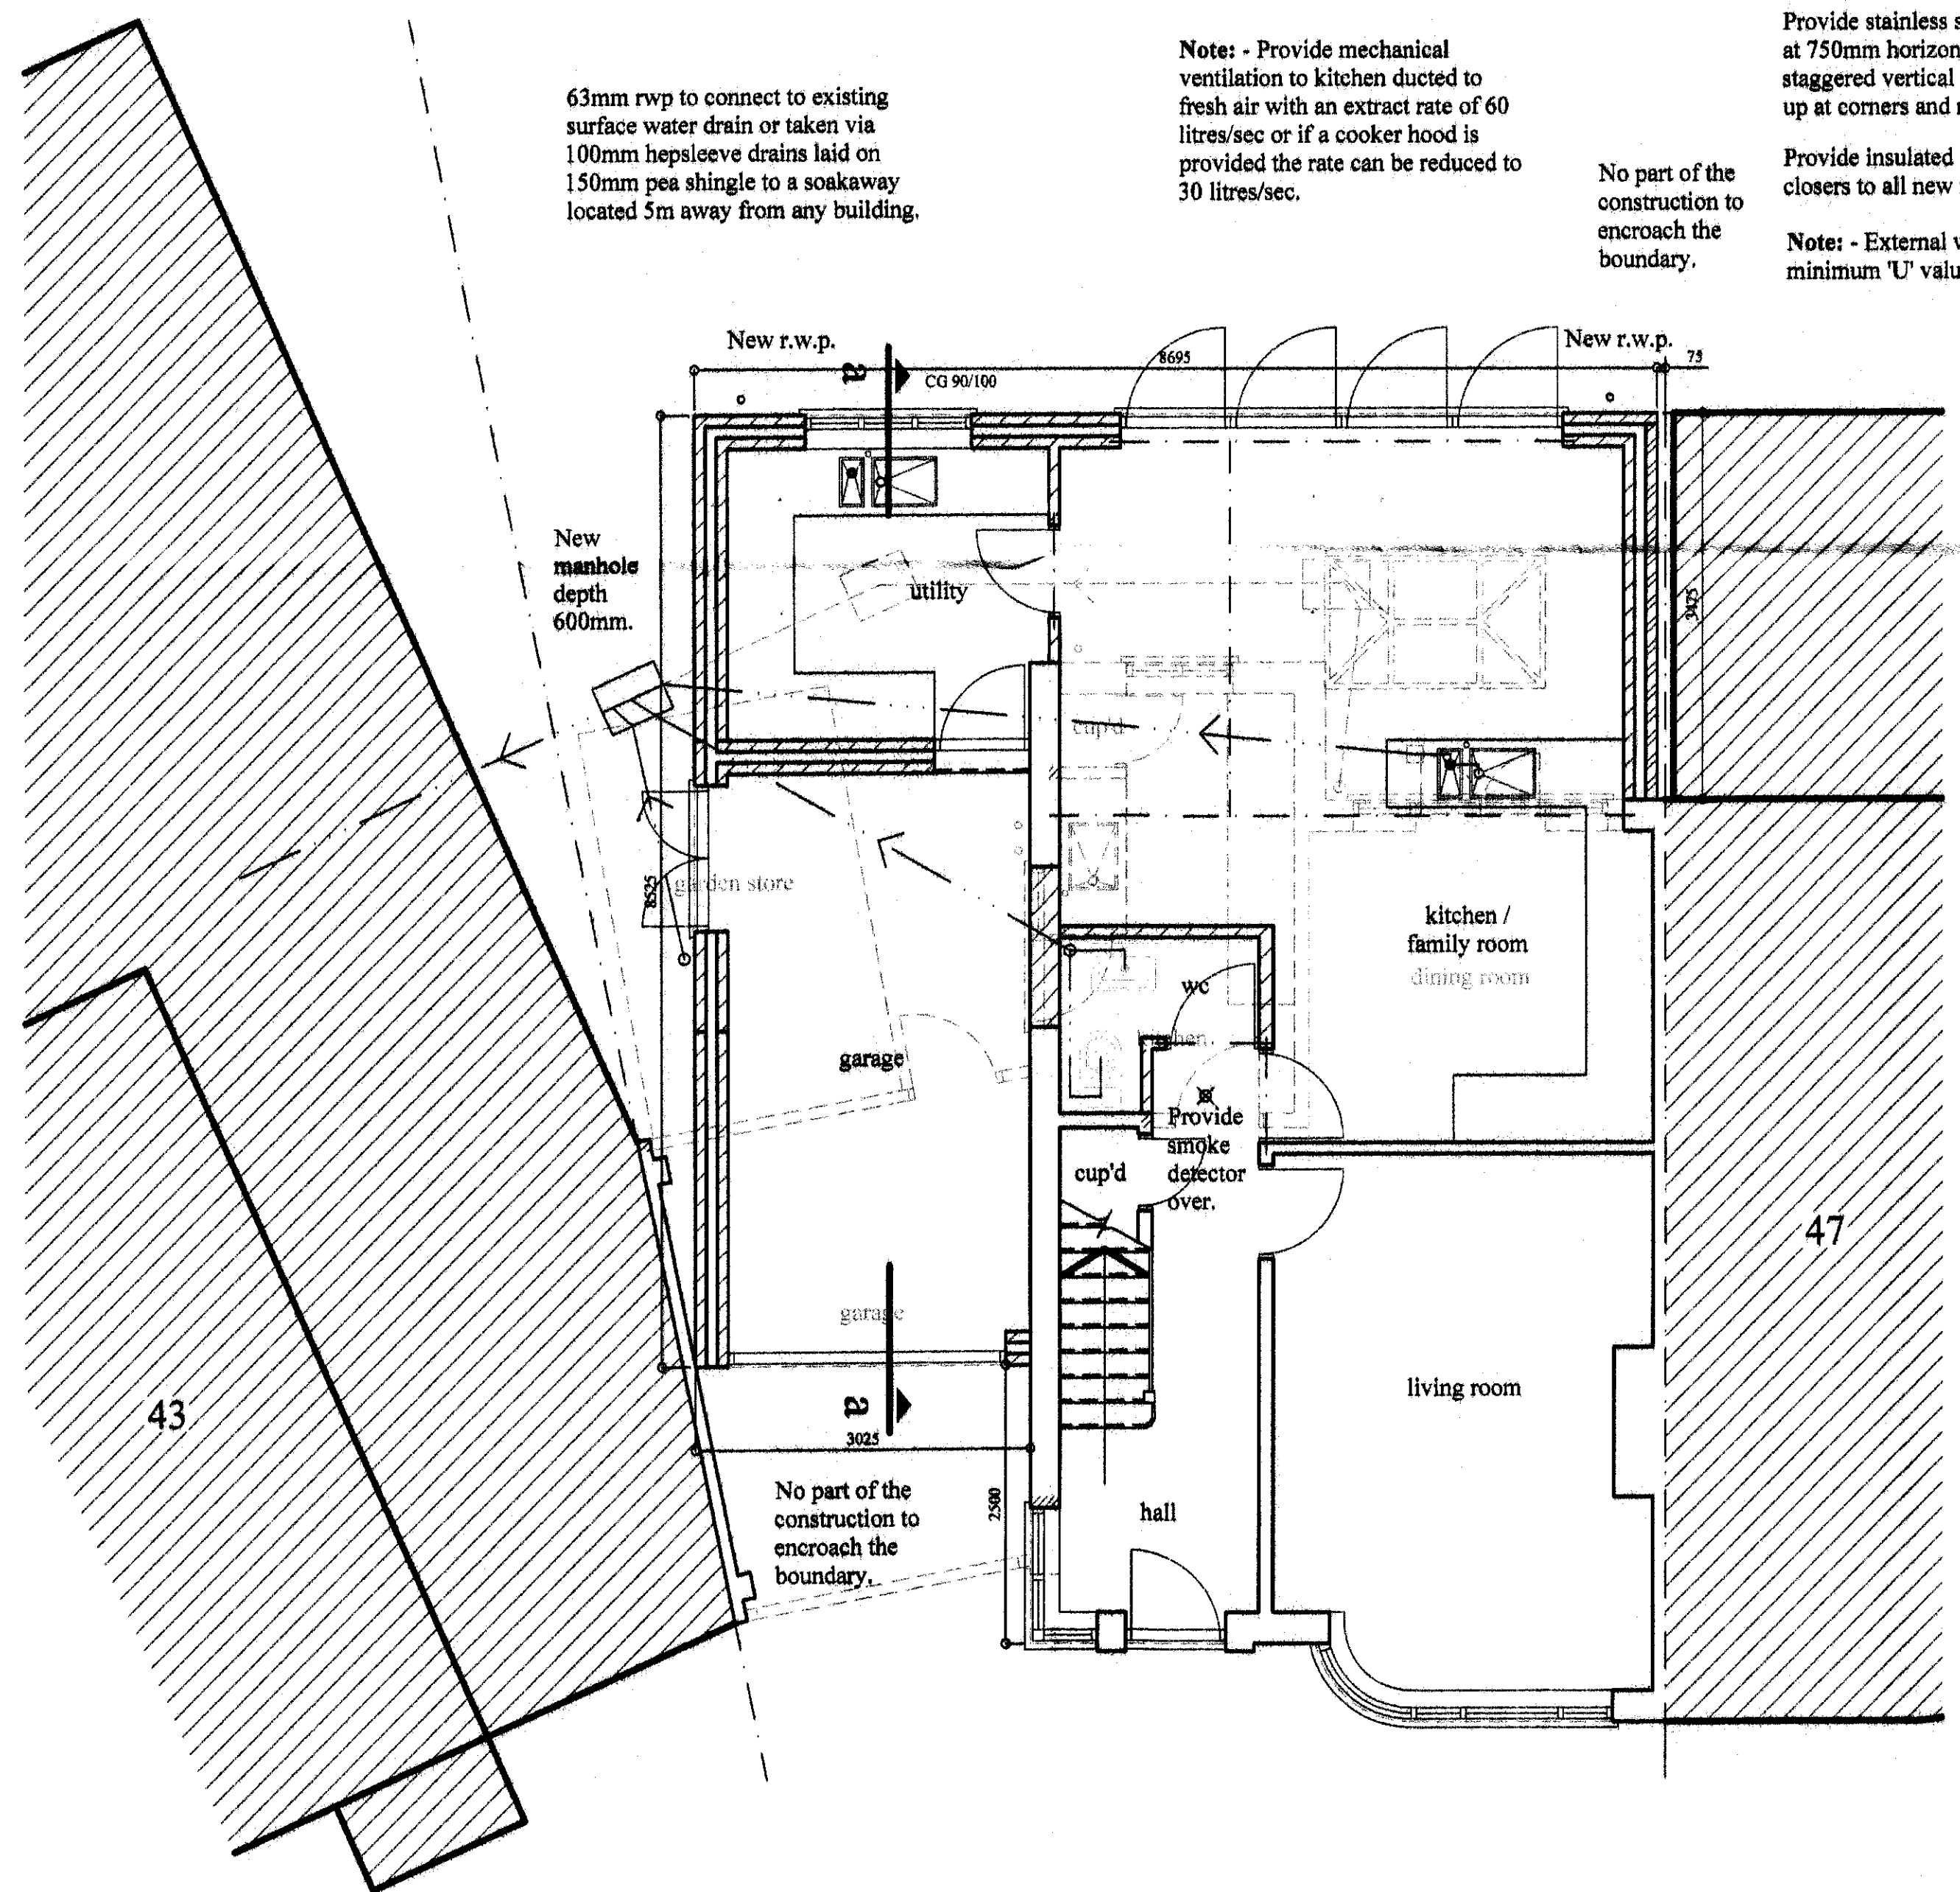

ground floor plan

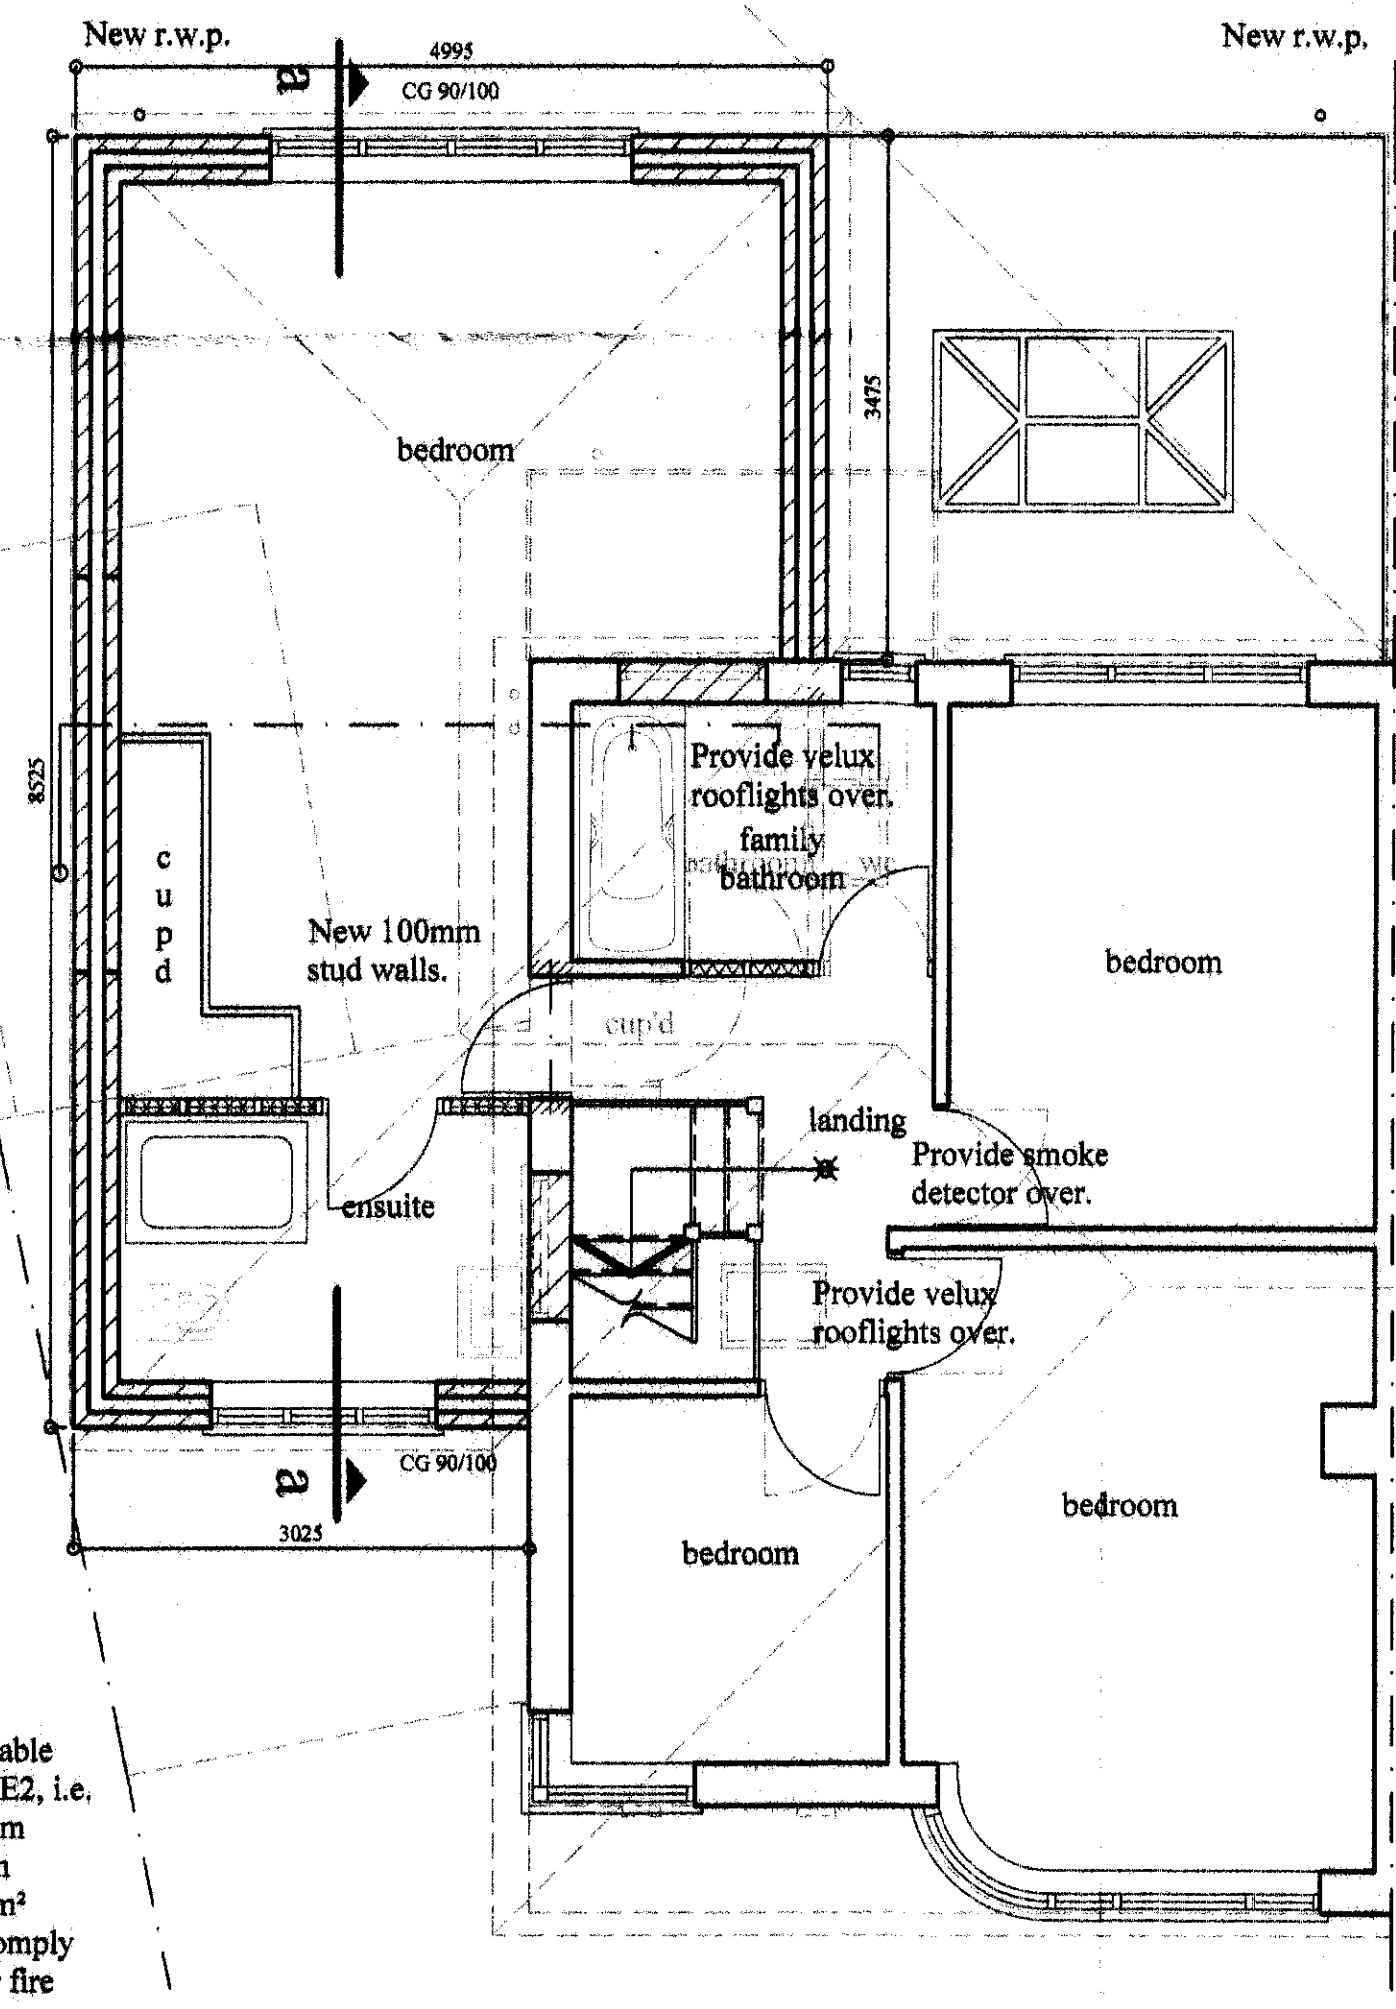

first floor plan



scale bar 1:50

Note: - Provide a self contained, mains operated, interlinked optical smoke detector system with battery back-up in accordance with BS 5839 or 5446 should be provided on each floor landing (ground floor and first floor landing levels) (B1). While giving due consideration to providing an additional smoke detector on the opposite landing so that each wing of the property is fully protected.

WELWYN HATFIELD PLANNING
- 6 MAY 2014
No:

B	24.04.14	To Clients Requirements.
A	18.04.14	To Clients Requirements.

Note: - Remove chimney breasts as shown dotted.

Revisions

Project
Proposed plans and elevations.
45 Bramble Road Hatfield Hertfordshire AL10 9RZ
Mr. M. Shinnick.

blyth developments
17 Sequoia Park
Hatch End, Pinner
Middlesex
HA5 4DG
T: 020 8428 6868

Scale 1:50 1:100
Date April 2014
Drawn By D. J. BLYTH.
Drawing No: **BD/14/16/2B**