



Note: Isometric drawing is for reference only, details may not accurately represent actual design please see detailed views for technical information

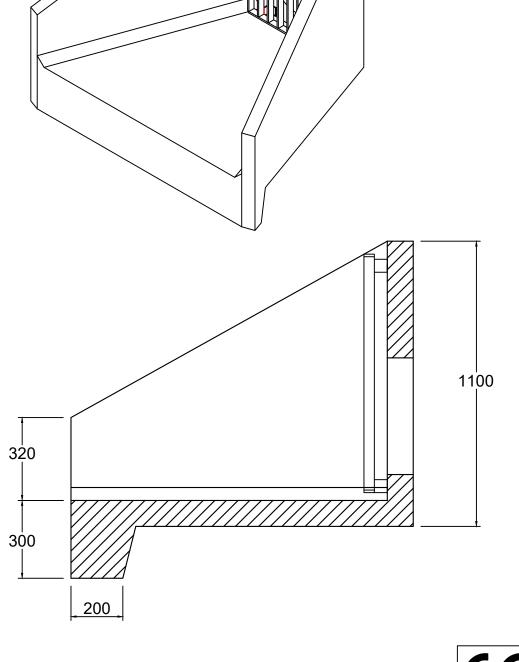

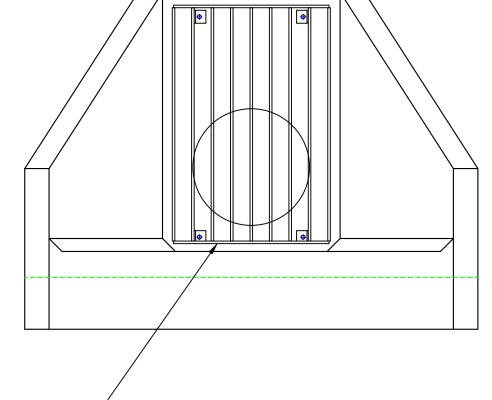

Close Coupled Grate Specification Information

- Grating manufactured from 40 x 10 flat at 75mm centres with 50 x 50
- angle mounting points
- Unit fully welded then hot dip galvanised

NOTES:

All dimensions in mm

<u>Specification Information</u>

Opening in back wall cast to suit outside diameter of the pipework

Invert level of pipe can be set to your specification

Units should be bedded on minimum 150mm of semi-dry concrete.

Sit the headwall level or with a slight fall 1:50 from pipe to spill mouth.

Handling
A. Weight of concrete is based on 2.4 tonne/m³+5% is recommended for sizing lifting

equipment. All lifting points shall be used as specified below - Anchor points & loops - Total

Unit to be lifted as per lifting diagram

- Concrete

 A. Mix ref: Self-compacting DC4/DS4 Mix

 B. Lifting strength based on 2 cubes = 20N/mm²

 C. Characteristic 28 day cube strength = 50N/mm²
- Concrete provides Design Chemical Class 4 (DC4) to special Digest 1, Table F2.

- Reinforcement
 A. Reinforcement to BS EN 13369
- Scheduling, dimensioning, bending & cutting to BS8666
 Cage to be machine tied with steel wire

- Manufacture to BS EN 15258:2008 precast concrete products Retaining wall elements, Factory Production Control certificate number: 0086-CPR-650448 & BS EN 13369
- Tolerances to BS EN 13369 clause 4.3.1.1

- Marking: Units shall be indelibly marked to show Mould reference code

- De-mould date
 Job reference number & unique product number
 Unit weight (kg)

- Concrete design to EC2
 Althon have designed the concrete units only, the site conditions should be assessed for suitability by the scheme designer assessed for surfamily by the scrieme designer

 Units are designed to withstand a vertical live load surcharge of 10kN/M²

 Weight of soil = 18kN/M²

 Angle of internal friction = 30 Deg.

 Design Life: >50 years

	Exposure induced	Corrosion induced	Freeze/thaw	Chemical
	by Carbonation	by Chloride	attack	attack
All Faces	XC3/4	XD2	XF3	XA2

- Fabrication Specification
 A. Manufacture IAW EN 1090-2 EXC CLASS 1
- Material grade is to be: BS EN 10025 S275
 Welding carried out IAW EN 1090-2 PARA 7.5.4 7.5.18
- All fillet and butt welds to have a minimum throat thickness of 6mm & joints to be fully welded where possible.
- Ensure vertical flats are fully welded both sides where possible.
 All sharp edges and burrs are to be removed.
 Remove all weld splatter.

- Holes by punching are permitted with reaming.
 Galvanising is carried out after fabrication to BS EN:ISO 1461

- <u>หาสมาราชยะแนะสนยนา</u> Kee Klamp® Galvanised Size 8 Fittings Size 8 48.3mm OD 3.2mm Wall Thickness Galvanised Medium Duty Tube to BS EN 10255 360N/m Design Load at stated in BS 8118, BS 6180, BS 6399 & BS 7818, Civil
- Engineering Specification for thw Water Industry (CESWI) 7th Edition Clause 2.60 Handrails & Balusters & The Engineering Equipment and Materials Users' Association (EEMUA) Publication 105 7th Edition Factory Stairways, Ladders and
- Other design loads available on request GRP/FRP Handrails also available



DRAWING TITLE / PROJECT:

H6CA Headwall Close Coupled Grating

CLIENT:								
SCALE:		PAPER:	SHE	SHEET NO:		DATE:		
	NTS	A3	;		01 OF 02		26 - 04 - 18	
HEADWALL WEIGHT:				П	TOE WEIGHT:			
1150kg						N/A		
PRODUCT NAME: H6CA								

DO NOT SCALE DRAWING