




SPECIFICATION AND DESIGN CONSIDERATIONS

- Back gutter and Cover flashings minimum code 4 in lengths not exceeding 1500mm
- Soakers minimum code 3
- Where deeply profiled tiles are used and/or additional thickness is required for bossing and for Historic or Listed Buildings min. code 5 should be specified.
- Where stack width exceeds 500mm ensure free edges of apron flashings are clipped to suit exposure see Detail Sheet No. 7 Apron Flashings at Abutments.
- Chimney Stack brickwork ensure flashings are fitted in correct relation to any damp proof tray. See publication reference.
- Patination oil. Consider use to reduce risk of staining over slated or tiled areas.
- Type of side flashing will vary depending upon type of tiles or slates.

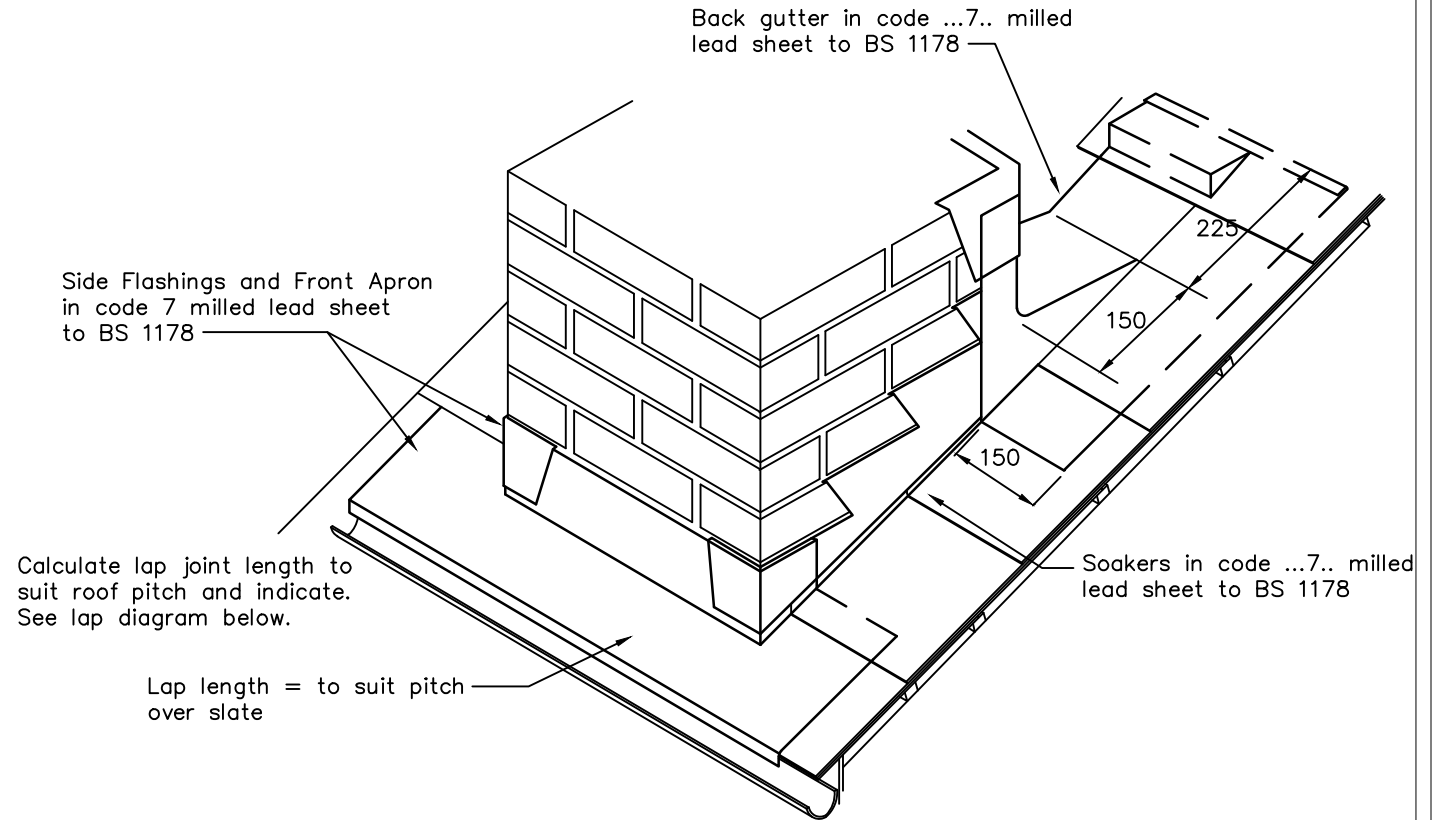

Calculate lap joint length to suit roof pitch and indicate. See lap diagram below.

Lap length = to suit pitch over slate

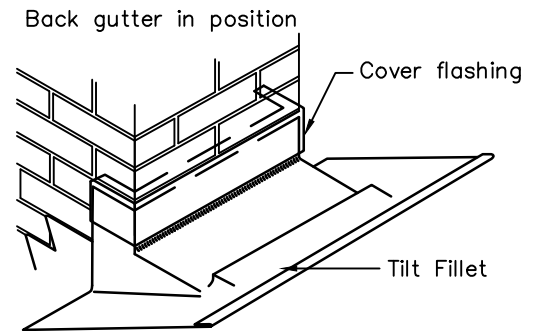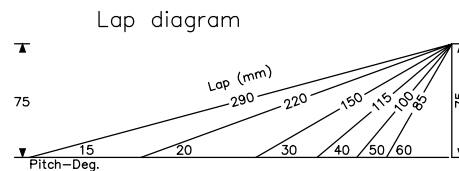

Lead Sheet Association
Telephone 01892 513351
Fax 01892 535028



Standard Detail Sheet No. **16F**
Title: Chimney Flashings

Contract Information

Practice Details

Publication Reference Lead Sheet Manual Volume **ONE**
Page Nos **8, 9, 13, 14, 15, 17, 26 to 33**