

# AIRBORNE FIBRE SAMPLING & ANALYSIS CERTIFICATE



**Client** Daleraven Ltd

**Address** 11 Elder Way, Slough, Berks, SL3 6EP

**Site address** Borne Group, Campus West Car Park,, The Campus, Welwyn, AL8 6BX

**Analysis Location** Site \*

**Report No:** 220804/971950/JS/07092  
0221107

**Attention of:** Peter Bottomley

**Sample Date:** 07/09/22

**Analysis Date:** 07/09/22

**Issue Date:** 07/09/22

Microscope ID	05309	Service due	16/03/23	Exposed filter diameter (mm)	22	NPL band resolution	5	Graticule diam (µm)	102	Page	1
Flowmeter S/N	04798   04098	Timer S/N	05310	Counter S/Ns	02187   02188	NPL test slide no.	04085	Stage mic. S/N	04094	of	3
Cal due	01/11/22   01/11/22	Cal due	01/06/23	Check due	23/11/22   23/11/22	Cal due	23/11/22	Cal due	23/11/22		

Sample No.	Test Type*	Location	Pump No.	Cowl No.	Time			Indicated flow rate (L/min)			Intermediate		Volume (litres)	Fibres	Fields	Calculated Result f/ml	Reported result f/ml
					Start	Finish	Total	Start	Finish	Mean	Time	Flow					
01	B	Adjacent to trench	04007	04120	11:47	12:29	42.0	12.0	12.0	12.0	N/A	N/A	504.0	2.0	200	0.001	<0.01
02	B	Adjacent to trench	04853	04122	11:49	12:31	42.0	12.0	12.0	12.0	N/A	N/A	504.0	5.5	200	0.003	<0.01
03	FB	Field Blank	N/A	04112	N/A	N/A	N/A	N/A	N/A	N/A	N/A	N/A	No count required				
04	B	Home Dining Room - Site Lab	04007	04126	20:45	21:17	42.0	12.0	12.0	12.0	N/A	N/A	504.0	4.5	200	0.002	<0.01

No more tests

\*Test type L=Leak, R=Reassurance, C=Clearance, B=Background, P=Personal, N=Near source static, F=Far source /Perimeter, FB=Field Blank

ISSUING OFFICE: Romford

ANALYST: Jamie Stacpoole

SIGNATURE:

SOCOTEC Asbestos Limited, Bretby Business Park, Ashby Road, Burton upon Trent, Staffordshire, DE15 0Y; Tel: 01283 554499

AAM-Air V02 Oct-17

Sampling and analysis carried out following internal procedures SCI/ASB/005 for airborne fibre sampling and SCI/ASB/006 for airborne fibre counting based on the main procedural points of HSE guidance document HSG248 'Asbestos: The analysts' guide for sampling, analysis and clearance procedures. The opinions and interpretations indicated are outside the scope of our UKAS accreditation.




# AIRBORNE FIBRE SAMPLING SITE DIAGRAM



<b>Clearance Details:</b>	Asbestos Type	N/A	Number of test required	0	Enclosure area (m2)	0	Dust disturbance method	N/A
	Enclosure volume	0 m3	Enclosure intact?	N/A	Enclosure dry?	N/A	Dust disturbance duration	0 min

**Description of Work:** Reassurance air monitoring following the excavation of suspect asbestos cement debris

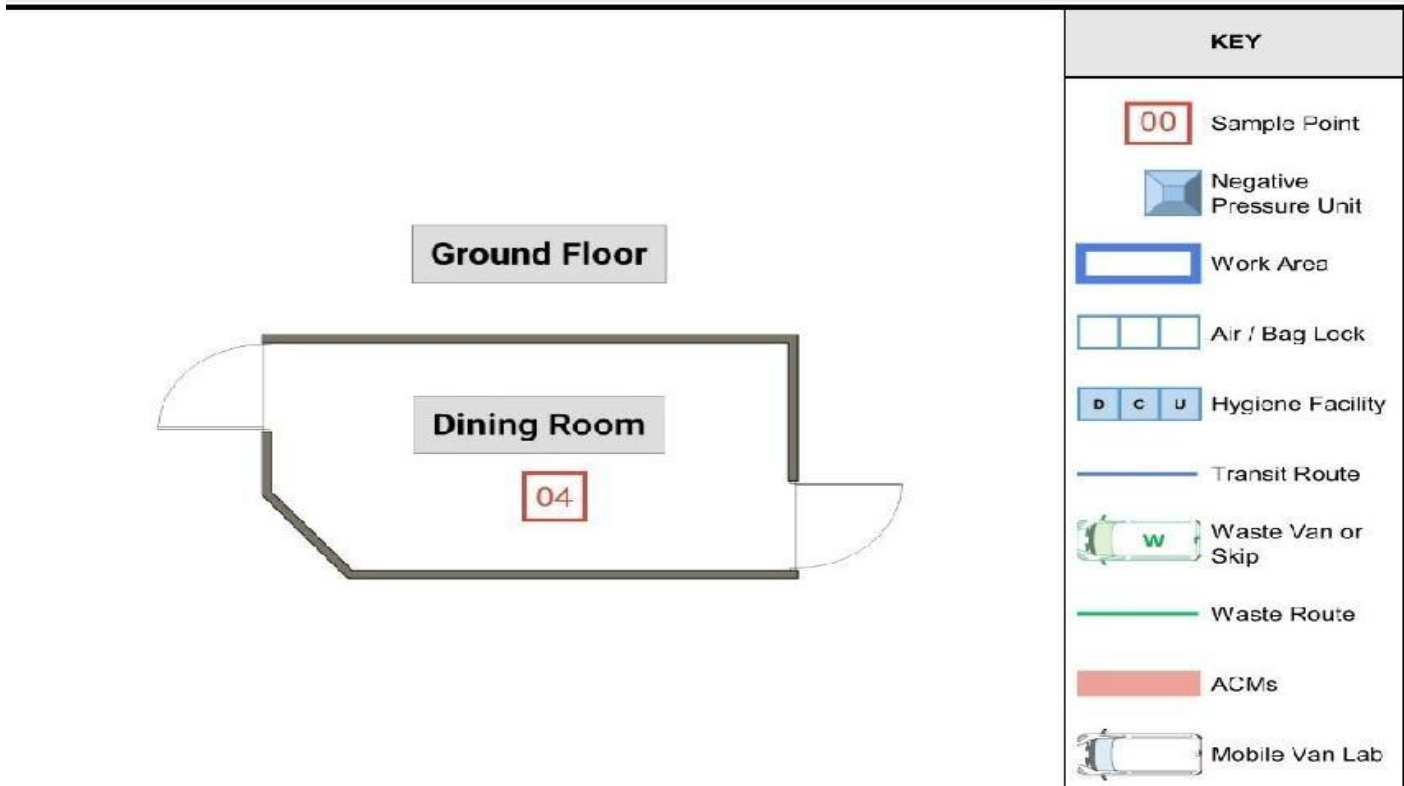

Contractor: Jamie Stacpoole

Analyst: Jamie Stacpoole

**NOTE: DIAGRAM NOT TO SCALE**

AAM-Air V02 Oct-17

This document shall not be reproduced except in full, without written approval of SOCOTEC Asbestos Ltd  
 SOCOTEC Asbestos Limited, Bretby Business Park, Ashby Road, Burton upon Trent, Staffordshire, DE15 0YZ

Tel: 01283 554499