


GENERAL NOTES:

- This drawing is to be read in conjunction with all relevant Architects and Engineers drawings and specifications.
- Do not scale from this drawing. All details and dimensions and levels are to be checked by the contractor prior to commencement of construction. Any discrepancies are to be reported to the Engineer.
- All levels are in meters & dimensions in millimeters unless noted otherwise.
- Design based on topographical survey and CCTV survey information available at the time of design. All existing sewers, connections, pipe sizes and invert levels to be confirmed by contractor prior to commencement of works to ensure connectivity. Any variance from the information shown should be reported to the engineer for review.
- Where existing drainage is being used, allowances should be made to remediate this drainage in line with available CCTV survey information.
- Where there is no requirement to keep existing drainage, allowances should be made to abandon this in line with Curtins drainage specification.
- Any new gully and external surface water inlet positions and associated falls to them are shown indicatively and to be designed set out by the Landscape Architect.
- Cover levels should be confirmed against Landscape Architects level design. Any discrepancy should be raised and coordinated to the engineer ASAP.
- All internal drainage points are shown indicatively and are to be designed and set out by the M&E Engineer.
- Any drainage runs and their connections damaged through construction works should be replaced to sufficient standard.
- Diversion and abandonment of services associated with these designs by others.
- Lateral connections from internal drain points should be sized to match above ground designs, with minimum size of 1000.
- Infiltration to ground from permeable paving areas to be confirmed by further geo-technical review.
- Surface water restricted to Greenfield runoff rates. 5 l/s/ha for total site area of 3.79 Ha equates to 19.95 l/s for the entire site.
- S100 Application required for new connection to public sewer.
- Pipe diameter indicative only. Capacity check to be carried out to confirm proposals.
- Further co-ordination required with Structural Engineers.

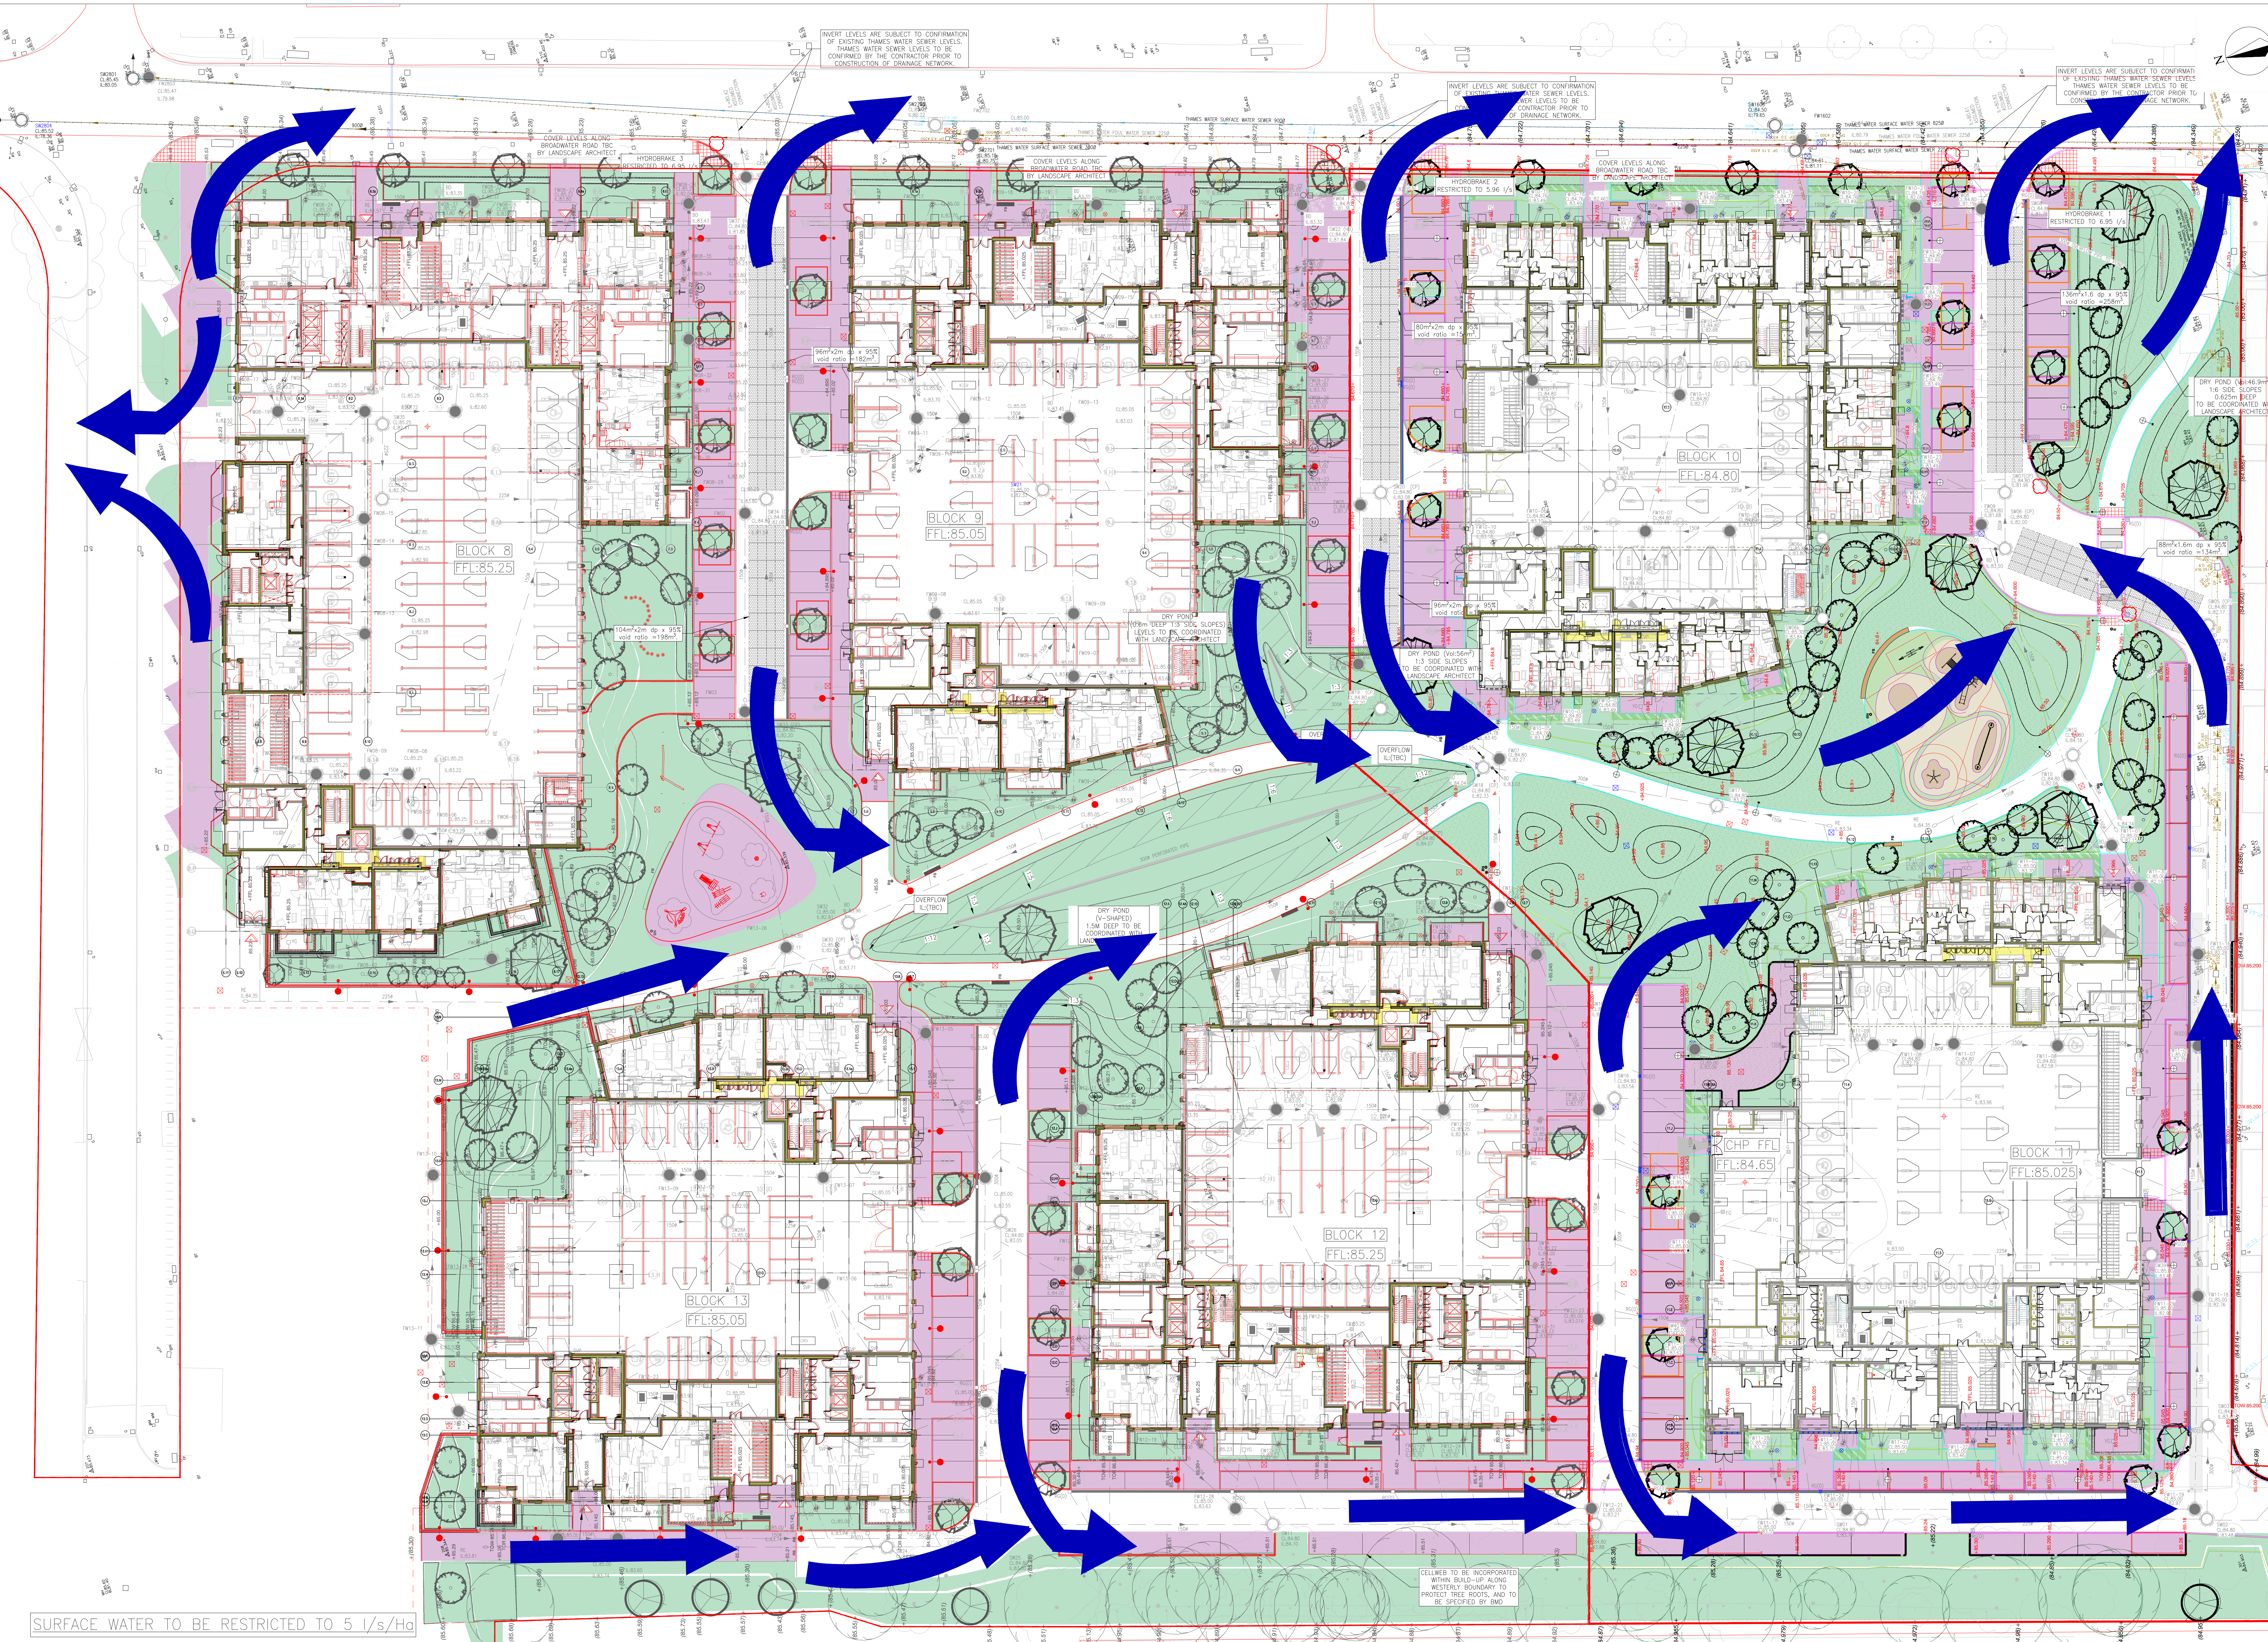

SURFACE WATER TO BE RESTRICTED TO 5 l/s/ha

DISTRIBUTION OF ATTENUATION VOLUME ACROSS SITE TO BE CONFIRMED BY DETAILED HYDRAULIC MODELLING AND CONFIRMATION OF SUDS PROPOSALS FROM PLANNERS.

PERMEABLE PAVING AREAS DESIGNED TO SELF ATTENUATE DUE TO UNDERLYING CHALK. YARD GULLIES IN PATIO AREAS MAY BE ABLE TO DISCHARGE TO GROUND INFILTRATION TO BE CONFIRMED BY GEO-TECHNICAL REVIEW.

P01 FIRST ISSUE		15.10.19	EB	LG
Rev	Description	Date	By	Chk
1				

40 Compton Street, London, EC1V 9BD
020 7294 2200
london@curtins.com
www.curtins.com

Client: Shredded Wheat - Transport Planning - Environment - Infrastructure - Development - Commercial & Heritage - Project Designer
Borough: Shredded Wheat - Transport Planning - Environment - Infrastructure - Development - Commercial & Heritage - Project Designer
Status: STAGE 4
Project: SHREDDED WHEAT, METROPOLITAN
Dwg Title: FINAL EXCEEDANCE ROUTE (1in100)
Size: A0
Date: 15.10.19
Scale: 1:250
Drawn By: E.BUSSETT
Designed By: L.GLAZA
Checked By: L.GLAZA
Project No: 066571 - CUR - 00 - 00 - DR - C - 98010 - P01